


PLAN

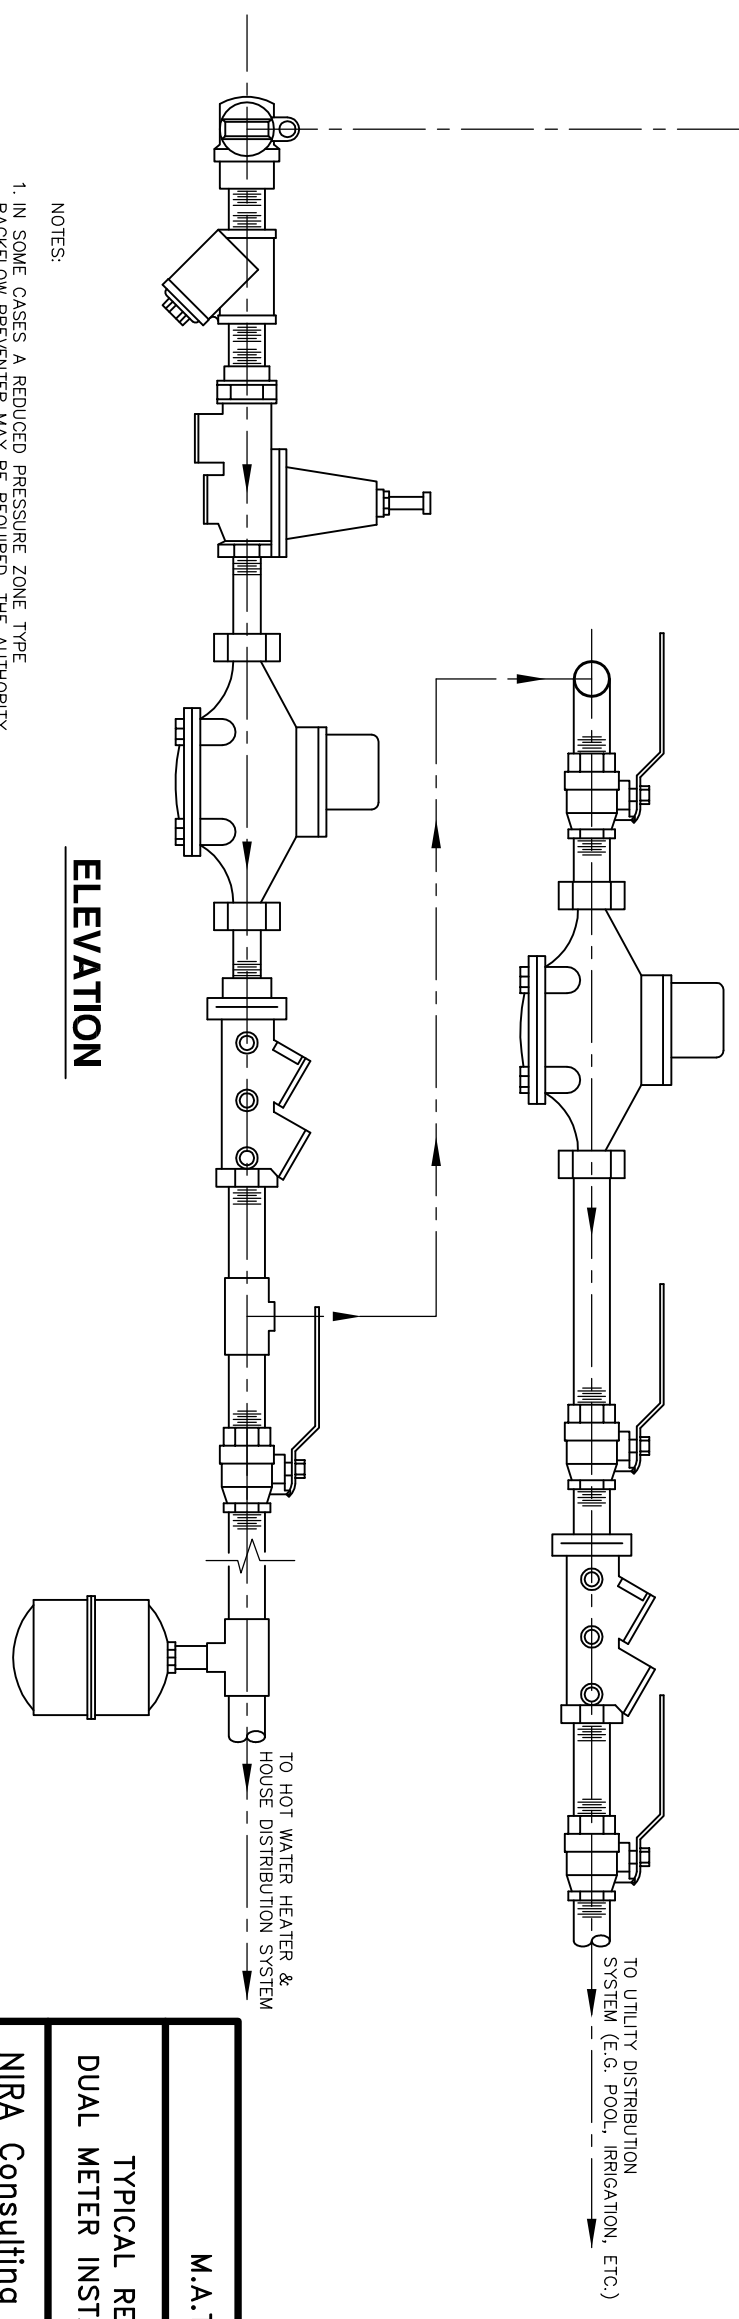

ELEVATION

- NOTES:
1. IN SOME CASES A REDUCED PRESSURE ZONE TYPE BACKFLOW PREVENTER MAY BE REQUIRED. THE AUTHORITY SHALL MAKE THIS DETERMINATION
 2. ALL PIPE & FITTINGS FROM FLARED ANGLE VALVE THROUGH LAST BALL VALVE MUST BE BRASS THREADED.

M.A.T.R.	
TYPICAL RESIDENTIAL DUAL METER INSTALLATION DETAIL	
NIRA Consulting Engineers, Inc.	
DR. BY: C.J.R.	DATE: 02-06-08
CK. BY: D.J.E.	SCALE: N.T.S.
SHT. NO. 1 OF 1	CONTRACT: